

IMPORTANT SURVEY:

Lead and Copper Testing of Drinking Water



Your local water system is required to do lead and copper testing at least every three years at different locations within your distribution system. Your assistance is needed to help compile the data required to track the materials used in their customers' service lines and plumbing.

Thank you for helping them continue to provide clean and safe water to your community.

Please submit separate surveys for each property on which you are reporting.

Name _____

Best phone number to reach you should we have questions _____

Address: _____

City _____ State _____ Zip _____


What type of property are you reporting on today?

- Single Family Year Built Before 1982
 Single Family Built After 1982
 Multi Family Built Before 1982
 Multi Family Built After 1982
 Commercial
 Industrial

What material is your service line made of? **Check all that apply.**

To see where the service line is, see number 2 on the illustration below.

- Lead
 Copper
 Galvanized steel
 P.E. (Polyethylene)
 Unknown

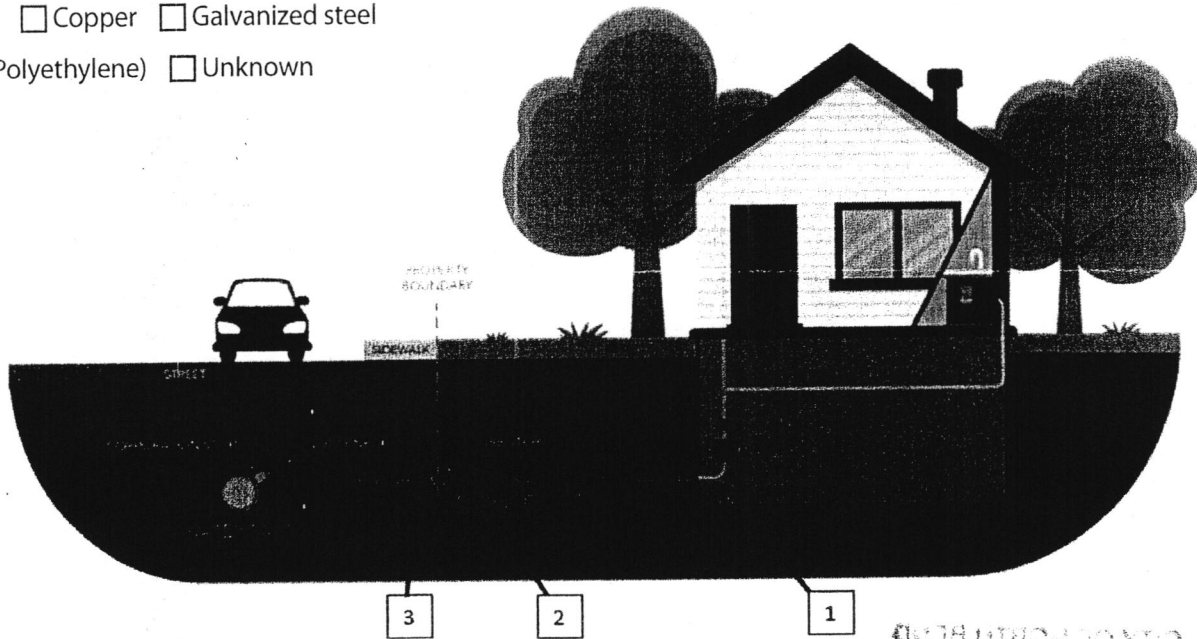

Continued on next page »



PeopleService INC.
Water & Wastewater Professionals

IMPORTANT SURVEY:

Lead and Copper Testing of Drinking Water




« Continued from previous page

Next, we need you to tell us what material your pipes are made of. You may use this helpful test to determine that.

Scratch test: Gently scratch the pipe with the flat edge of a screwdriver or other head surface. If the pipe revealed has a soft, silver or shiny surface, it is made of lead. If the scratch reveals an orange color, it is made of copper.

Magnet test: You may also touch a magnet to the pipe. If it sticks, the pipe is made of iron or steel. If it does not stick, it is made of lead or copper.

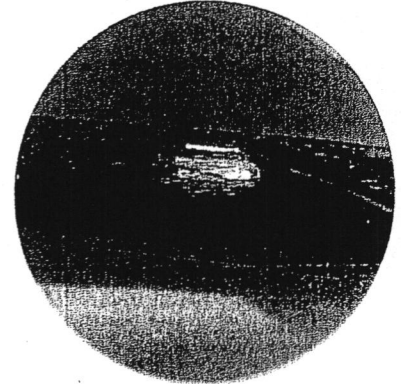

Please tell us your findings:

Lead Copper Galvanized steel PVC PEX

How old are the pipes inside your house?

Installed Before 1982 Installed After 1982

Do you have a water softener or a whole home water purification system or any other treatment device installed in your house or business?

Yes No

If you answered yes to the question above, do you have a faucet or spigot that is not connected to the water softener or home purification system?

Yes No

If your home or business meets the criteria for lead and copper sampling, would you be willing to participate in this testing? During testing, a city water representative will bring an empty bottle to your house, provide you with documentation and instructions on collecting the sample, and pick it up the next morning. Sampling frequency is typically every three years.

Yes No

Return to:

CITY OF NORTH BEND
BOX 401 - 607 MAIN
NORTH BEND, NE 68649-0401
(402) 652-3584



PeopleService INC.
Water & Wastewater Professionals